





**2013 CA ELECTRICAL CODE  
300-4**

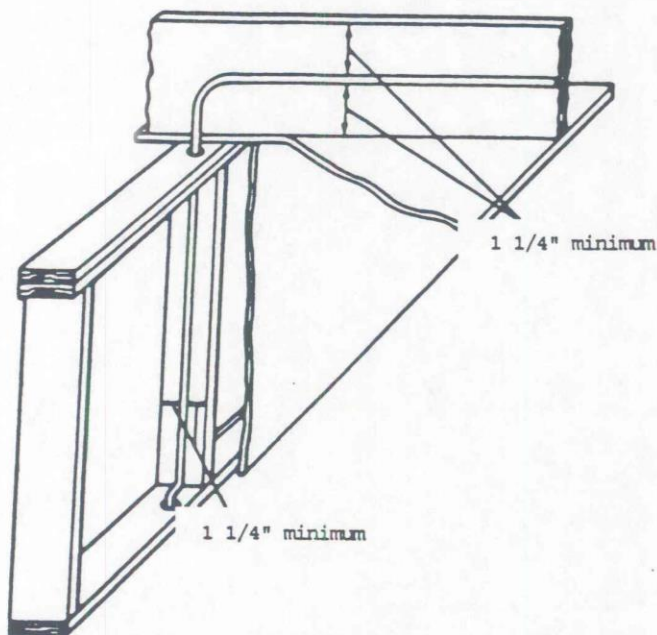

Parallel installation of cables and raceways can be installed closer than 1 1/4 inches from the edge of the framing member if physical protection is provided

NMS cable must be located 1 1/4 inches from the edge of a stud or joist or protected from damage by 1/16 inch thick metal plates. Cables shall be protected when run through metal framing members by listed bushings or listed grommets.

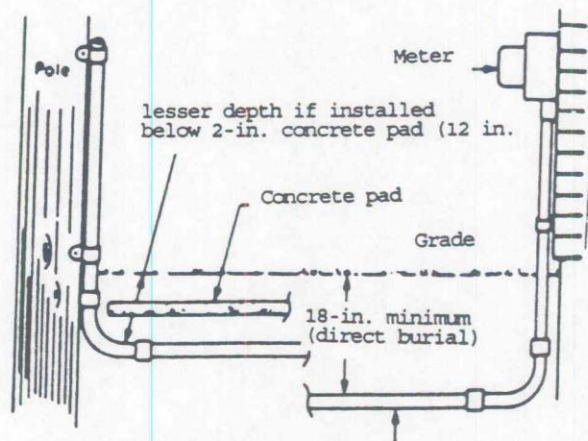

Rigid nonmetallic conduit and fittings may be directly buried in earth at a depth not less than 18 in.

exceed 600 V